

PROVISIONAL NOC FOR EDUCATIONAL BUILDING
GOVERNMENT OF ANDHRA PRADESH
FIRE & EMERGENCY SERVICES DEPARTMENT

From
The District fire Officer,
Railway Feeders Road,
Nellore Town,
SPSR Nellore District,
Andhra Pradesh 524001,

To
The Correspondent,
Audisankara College of Engineering and Technology,
Ramannapalem.North Rajupalem (V) Kodavalur (M).
SPSR Nellore Dist-524 366, Andhra Pradesh

Rc.No.7898 /A2/2024 dt, 06-12-2024.

Sir,

Sub: - FIRE & EMERGENCY SERVICES DEPARTMENT - S. R – SPSR Nellore district - issuance
of NOC for recognition of existing Audisankara College of Engineering and Technology. Ramannapalem.
North Rajupalem (V) Kodavalur (M). SPSR Nellore Dist-524 366. Andhra Pradesh -Reg. Ref.-I) Section 13
(2) of A.P FIRE services act, 1999 and rule 15 (2) of A P FIRE & Emergency Operations and levy of fee
rules, 2006.

- 2) Chief office memo. Instructions of Re. No. 2305/B2/17, dt. 28-02-17.
- 3) Application dt.19-11-2024 of correspondent, Audisankara College of Engineering and Technology.
Ramannapalem. North Rajupalem (V) Kodavalur (M). SPSR Nellore Dist-524 366. Andhra Pradesh
- 4) Inspection report of Asst. District Fire Officer, Nellore and Station Fire officer, Nello on 03-02-2023,
- 5) Rc. No.2305/B2/17, dt.22-11-24 & 29-11-24 of Director General of Fire and Emergency
Services, A.P. Vijayawada.
- 6) Challan No.35789, dt.19-11-2024 for Rs.12,860/- at sub-treasury, SPSR Nellore.

I) Vide reference 3rd cited, the correspondent Sri.Vanki Penchalaiah, has requested for issue of NOC for recognition of existing
Audisankara College of Engineering and Technology. Ramannapalem. North Rajupalem (V) Kodavalur (M). SPSR Nellore Dist-524
366. Andhra Pradesh (Fire Safety Measure Suggested for Ground + 3 Floor only)

2) Vide reference 4th cited the inspection Committee, i.e. Asst District Fire Officer, Nellore along with Station Fire Officer,
Nellore has inspected the building 03-12-2024 and recommended for the issue of NOC- The correspondent Audisankara College
of Engineering and Technology. Ramannapalem. North Rajupalem (V) Kodavalur (M). SPSR Nellore Dist-524 366. Andhra
Pradesh remitted and amount of Rs.12860/- towards Fire precaution Fee (Built-up-area 20843 sq. Mtrs) vide challan No.35789,
dated 19-11-2024 at sub-treasury, Tirupati as the plot area is above 500 sq. Mtrs. Accordingly the NOC is issued subject to
the following conditions.

3) Particular of the Building : R.C.C.Buildings.

Address of the building Audisankara College of Engineering and Technology. Ramannapalem. North Rajupalem (V)
Kodavalur (M). SPSR Nellore Dist-524366. Andhra Pradesh

- a) Area or Plot-lt. of bldg. : Ac.12.78./Height: 12.10 Mtrs
- b) Built-up Area : 20843 sq. Mtrs
- c) No. of Blocks/Floors : 01 Block, Ground+3 Floor only
- d) Types of Occupancy : Educational Institutions
- e) Floor-Wise detail : Ground + 3 Floor only

Sl.No	Floor	Area in sq. Mtrs	Occupancy (Educational/Hostel/Dormitory Occupancy)	Occupant load
1.	Ground +3 Floors	20843 sq. Mt	Educational Institutions	5000 Student

A) Strict compliance with all fire safety provisions as per the condition of Provisional No objection certificate, issued and par 4 national Building Code of India and of Building. particularly the following should ensured at all times.

1. The aggregate with/capacity or exists/stairs shall remain compliant with NBC for safe evacuation of occupants.
- 2 Fire-resisting doors to limit the spread ad or fire and for preventing smoke and finesses form entering exit stairs, lifts which impedes safe evacuation safe it is an essential pre-requisite for life safely.
3. No temporary Such as lens or with thatched construction should allowed for education institutions.
4. Every room with a capacity or 45 students shall be maintained obstruction free minimum two doorways.

B) Fixed firefighting Equipment as per table 23 part-4 or NBC

The following fire safety extinguishers shall be maintained in working condition at times.

C) (i) Fire Extinguishers:

The, following fire extinguishers shall be maintained in trim working condition fit all times. As per 15.3190:1992.

(a) Two 9 ltrs. Water expelling extinguishers and one 4.5 K2 CO2 extinguisher and one 5 kg. DCP Extinguisher for every 600sq.Mtrs. Radius.

(b) Four 9 ltrs. Round bottom Fire buckets (Two filled with water and two filled the dry sand) for every 600Sq.Mtrs. built up area/per floor should be hung to a stand*

D) Evacuation plan showing exit routes and recommended action plan be displayed at conspicuous locations shall be exhibited at all times.

E) Fire drills shall be conducted once in every 3 months in consultation with the local station Fire Officer.

1. Adequate ventilation to provide the prevent smoke logging and adequate precautionary shall be taken against fire.

2. Exists should not be blocked and staircases also

3. All electrical fittings should be concealed and no. open wires (or) Temporary connection shall not be used within the college premises.

4. Highly inflammable liquids Shall not be stored in the premises.

5. Cooking of food where essential should be done at a safe place away from the building where students are located for education.

6. Perfect good housekeeping is not maintained at the place at the place at all the times.

7. Naked lights/open Fires shall not be allowed in the Premises.

8. Whenever any further raise in the height or the building again, this department may be addressed a NO Objection Certificate 10 recommend for fixed fire fighting's Equipment as per scale prescribed in Table 23 part-4 of NBC

The correspondent is requested to pay special attention to S.NO.C and also the compliance of all the above norms to ensure life safety of the inmates at all times.


District Officer
SPSR Nellore District

Copy submitted to director general of Fire & Services, A.P. Vijayawada for Information


Copy submitted to the regional fire officer, S.R Vijayawada for information

Copy to the district Educational Officer, SPSR Nellore

Copy to Asst. District Officer, SPSR Nellore.

Copy to Station Fire officer, Nellore.

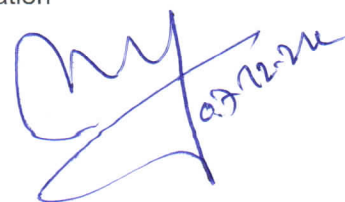


23/12/20